



INSTALLATION

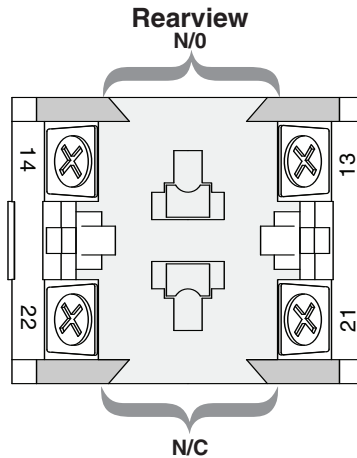

PBBH, PBRE, PBRR, PBKR

Push Buttons

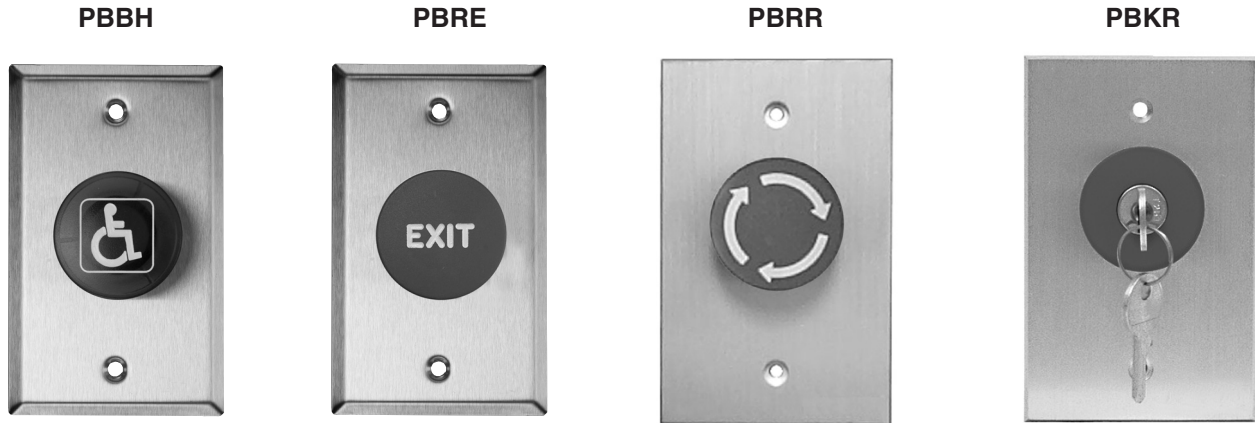

Description	Switch Mode	Switch Configuration	Switch Rating	Button Label
PBBH Handicap	Momentary Action	1 x SPST N/O & 1 SPST N/C	10A @24V UL/CSA	Blue Cap with Handicap Symbol
EA Timer	Adj. Delay 1- 30 sec*	SPDT N/O & N/C	5A @24V UL/CSA	Blue Cap with Handicap Symbol
EF Timer	Fixed Delay 30 sec.*	SPDT N/O & N/C	5A @24V UL/CSA	Blue Cap with Handicap Symbol
PBBH Handicap	Maintained Action	1 x SPST N/O & 1 SPST N/C	10A @24V UL/CSA	Blue Cap with Handicap Symbol
PBRE Exit Button	Momentary Action	1 x SPST N/O & 1 SPST N/C	10A @24V UL/CSA	Red Cap with Exit Wording
EA Timer	Adj. Delay 1 - 30 sec*	SPDT N/O & N/C	5A @24V UL/CSA	Red Cap with Exit Wording
EF Timer	Fixed Delay 30 sec.*	SPDT N/O & N/C	5A @24V UL/CSA	Red Cap with Exit Wording
PBRE Exit Button	Maintained Action	1 x SPST N/O & 1 SPST N/C	10A @24V UL/CSA	Red Cap with Exit Wording
PBRR Rotary Release	Maintained Action	1 x SPST N/O & 1 SPST N/C	10A @24V UL/CSA	Red Cap
PBKR Key Release	Maintained Action	1 x SPST N/O & 1 SPST N/C	10A @24V UL/CSA	Red Cap

*Mounted separately. N/C – Normally Closed; N/O – Normally Open **NOTE:** Specifications are subject to change without notice.